



MERCURY DISPLACEMENT INDUSTRIES, INC.

Post Office Box 710 - U.S. 12 East - Edwardsburg, Michigan 49112-0710

Phone (269) 663-8574 - Fax (269) 663-2924

(800) 634-4077


PANEL#: 50A754-C6

CONNECTION DIAGRAM

230V 3-PH DUPLEX

INCOMING POWER CONNECTION

REQUIRED TORQUE FOR TERMINAL BLOCK SCREWS IS

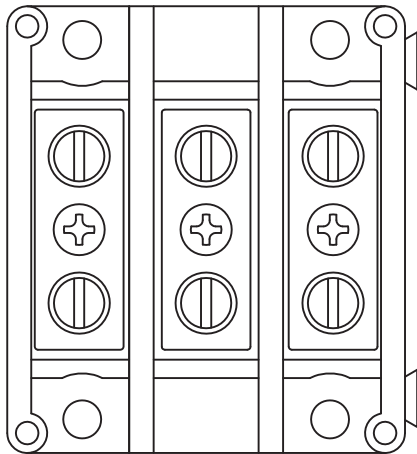

8 - 14 AWG = 35 in-lbs


4 - 6 AWG = 45 in-lbs

2 - 3 AWG = 50 in-lbs

N L1 L2
INC. 230VAC-1PH

PUMP & FLOAT CONNECTIONS

REQUIRED TORQUE FOR TERMINAL BLOCK SCREWS IS 16 in-lbs.

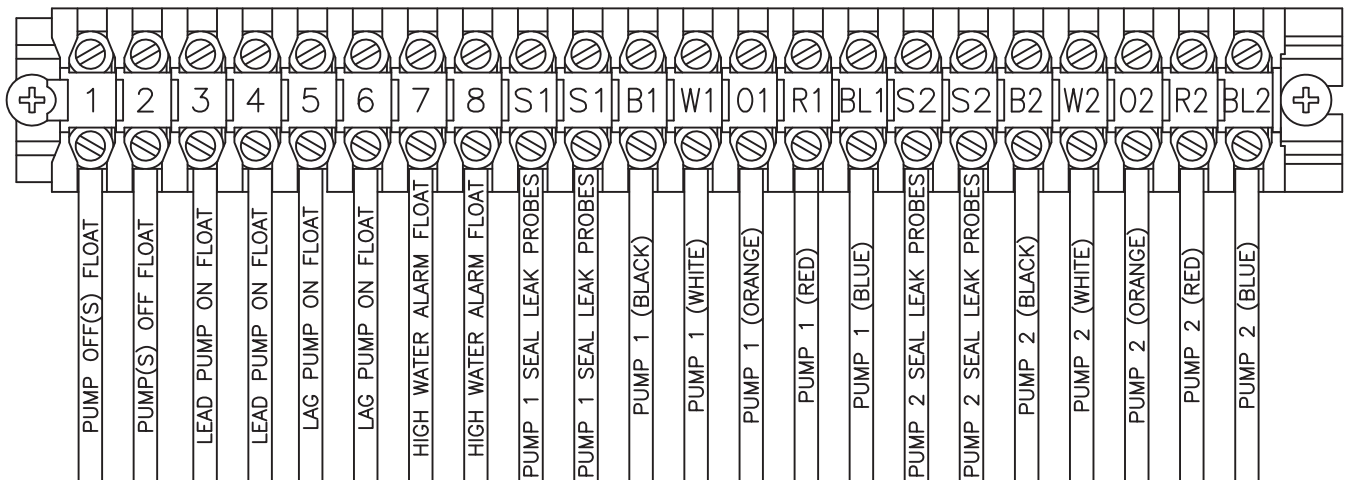

Contactors - Relays - Switches

<http://www.mdius.com>

POWER CIRCUIT
230V - 1PH

PUMP MOTOR MUST HAVE INTERNAL OVERLOAD PROTECTION.

